


NOTES:

1. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
2. OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.

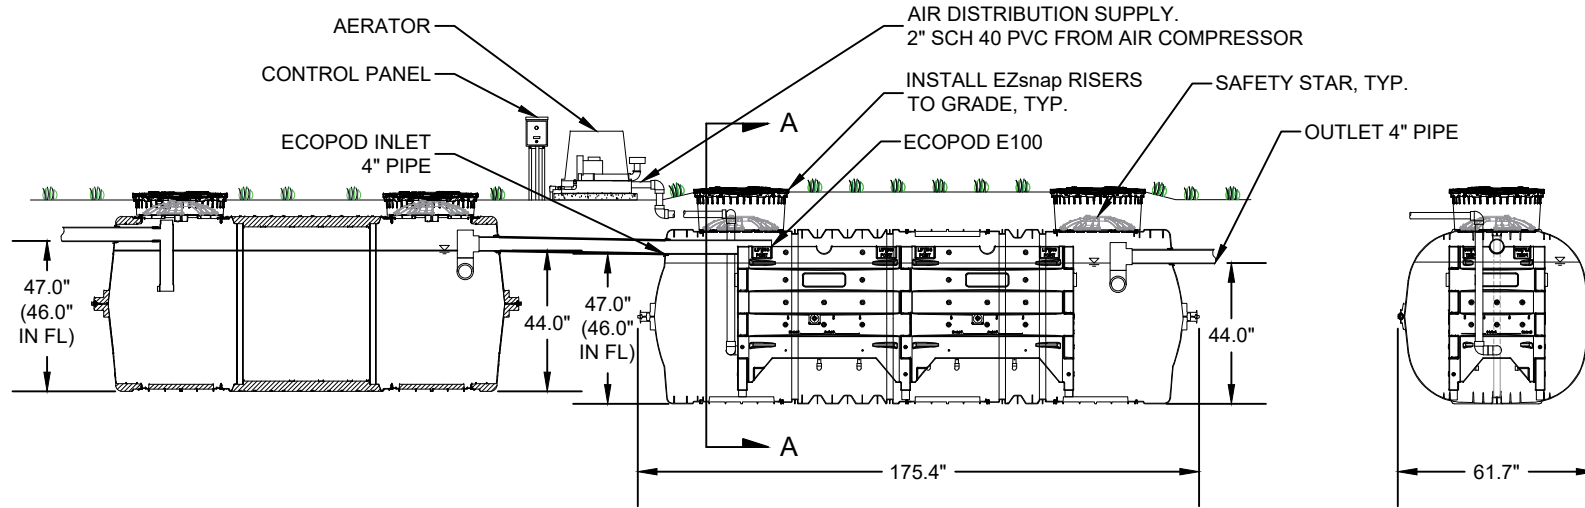

ELEVATION VIEW

SECTION A-A

ELECTRICAL REQUIREMENTS

|                          |                 |
|--------------------------|-----------------|
| TREATMENT PLANT          | E100N           |
| AERATOR                  | DELTA MODEL K03 |
| MOTOR FULL LOADS AMP     | 7.1             |
| MEASURED OPERATING WATTS | 475             |
| ELECTRICAL REQUIREMENTS  | 115V - 1PH      |

ECOPOD SPECIFICATIONS

|                                 |              |
|---------------------------------|--------------|
| TREATMENT PLANT                 | E100N        |
| TREATMENT CAPACITY (GPD)        | 1,000        |
| MIN. PRIMARY TANK VOLUME (GAL.) | 1,000        |
| REACTOR TANK VOLUME (GAL.)      | 1,405        |
| MEDIA SIZE                      | 8' X 2' X 2' |
| AIR REQUIREMENTS                | 24 CFM       |



INFILTRATOR WATER TECHNOLOGIES, LLC  
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475  
 WWW.INFILTRATORWATER.COM  
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM



E100NIM

PART NO.  
**E100N**  
 DATE  
 07/9/2024  
 SCALE  
**1:60**  
 SHEET NO.  
**01 of 01**