


NOTES:

1. INSTALL TANK PER PRECASTER INSTRUCTIONS.
2. IF PRECAST DIMENSIONS ARE OUTSIDE THE MINIMUM DIMENSIONS, CONTACT INFILTRATOR FOR REVIEW.
3. FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
4. OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.

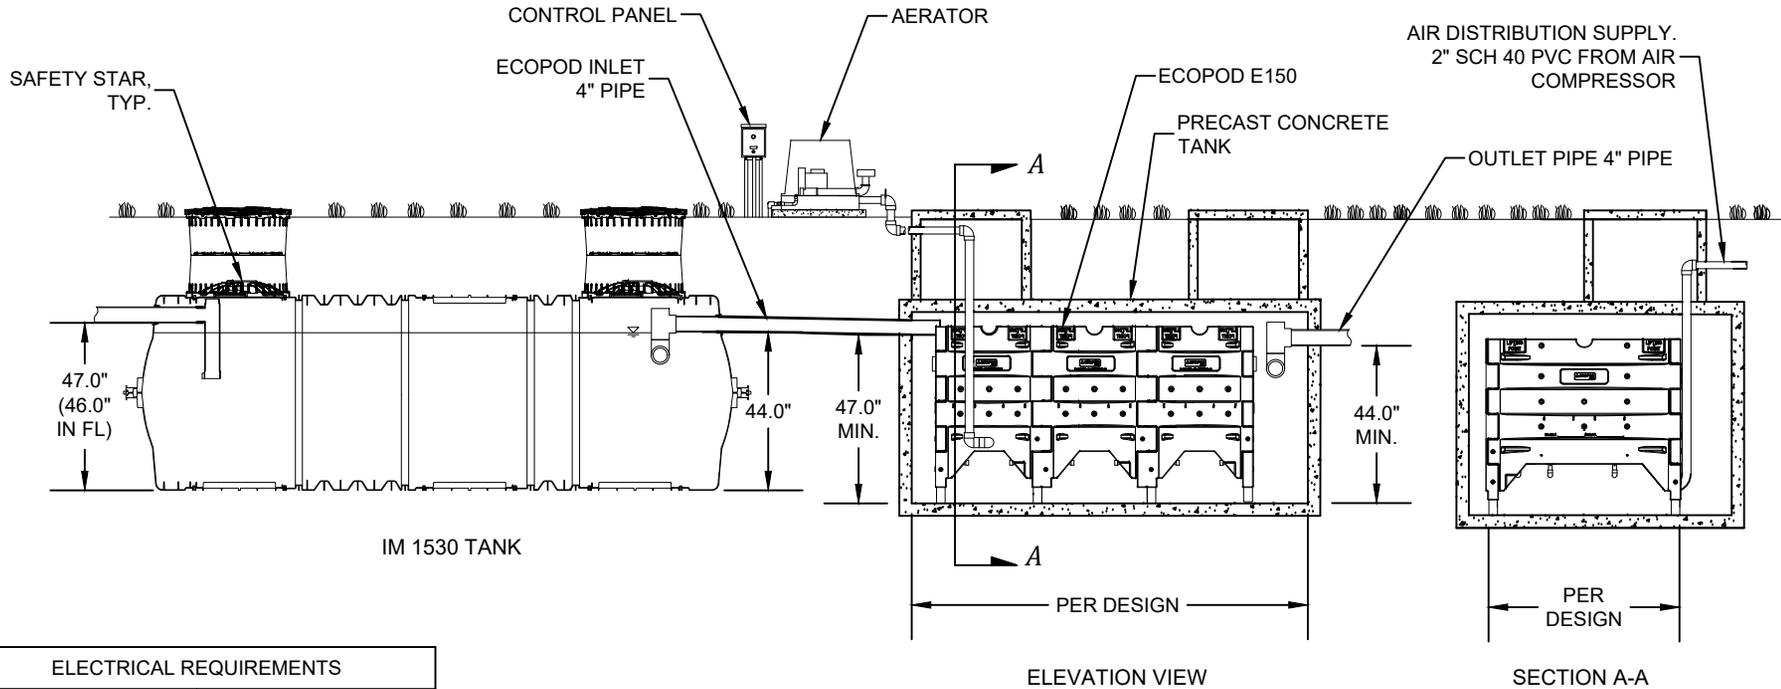

ELECTRICAL REQUIREMENTS	
TREATMENT PLANT	E150N
AERATOR	DELTA MODEL K03
MOTOR FULL LOADS AMP	7.1
MEASURED OPERATING WATTS	475
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS	
TREATMENT PLANT	E150N
TREATMENT CAPACITY (GPD)	1,500
MIN. PRIMARY TANK VOLUME (GAL.)	1,500
REACTOR TANK VOLUME (GAL.)	2,100
MEDIA SIZE	24" X 24" X 48"
AIR REQUIREMENTS	36 CFM

REV.	DATE	DESCRIPTION



INFILTRATOR WATER TECHNOLOGIES, LLC
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475
 WWW.INFILTRATORWATER.COM
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM

COPYRIGHT (C) 2024 INFILTRATOR WATER TECHNOLOGIES, LLC (IWT). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF IWT. NO PART OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN PERMISSION OF IWT. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS AND IS FOR BUDGETARY OR PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMINING THE APPLICABILITY TO A SPECIFIC PROJECT IS AT THE SOLE DISCRETION OF THE USER AND/OR THE ENGINEER OF RECORD.



E150NCA

PROJECT NO. P/N	SCALE N/A
DATE 11/26/2024	DRAWING NO. P1.0
DESIGNED BY AM	SHEET NO. 01 of 01
DRAWN BY AG	

CONFIDENTIAL

C:\Users\ahs\Advanced Drainage Systems\DEP - Drawings\By Product\ECOPOD\NCA\ECOPOD E150 IN CONCRETE BUNDLE Rev A.dwg