


NOTES:

- FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
- OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.

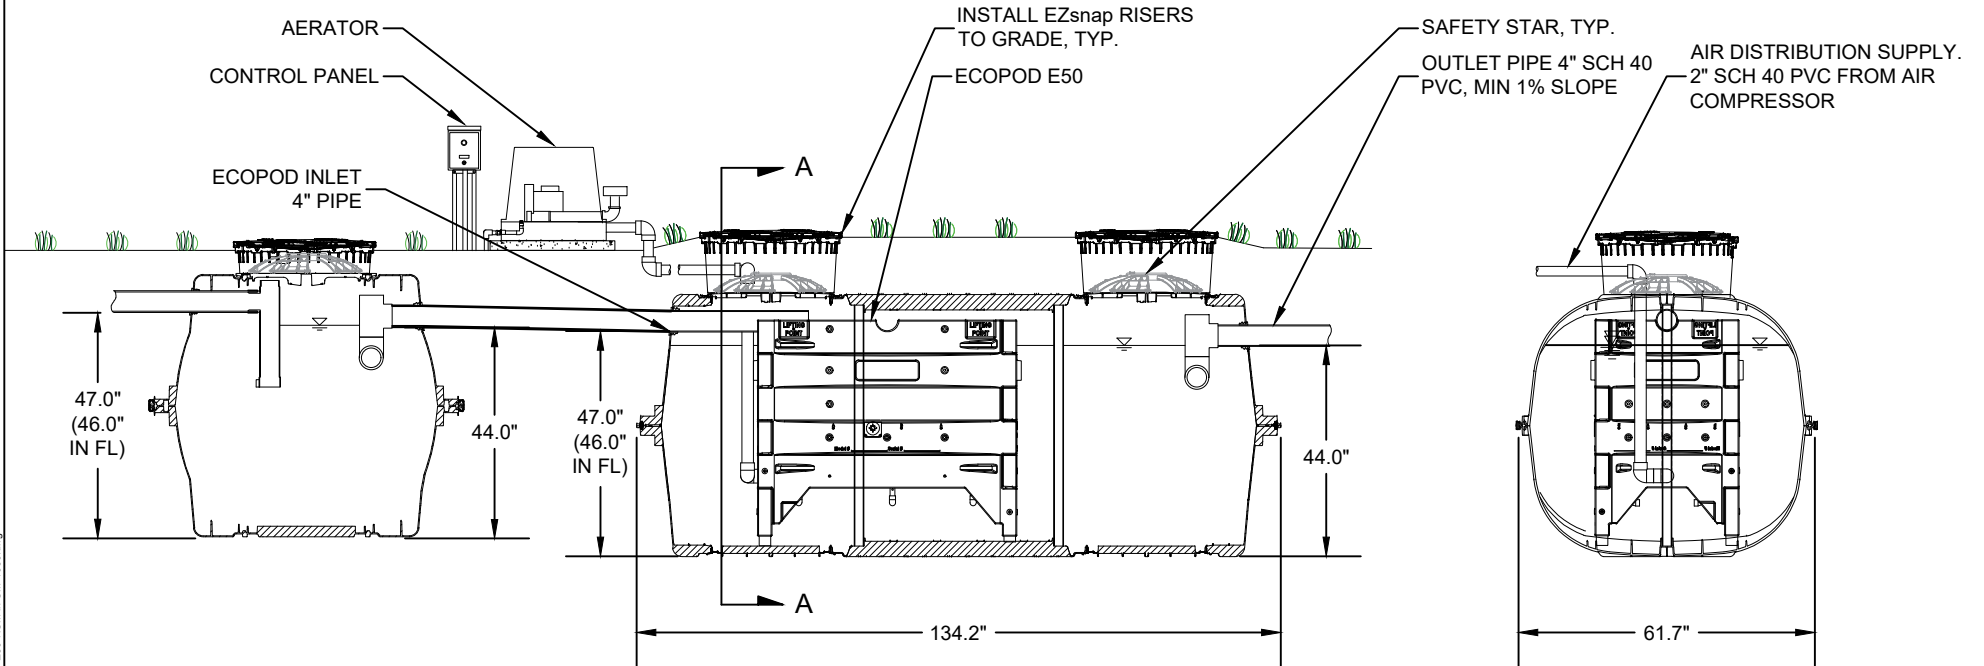

ELEVATION VIEW

SECTION A-A

ELECTRICAL REQUIREMENTS

TREATMENT PLANT	E50N
AERATOR	DELTA MODEL 06
MOTOR FULL LOADS AMP	3.5
MEASURED OPERATING WATTS	185
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS

TREATMENT PLANT	E50N
TREATMENT CAPACITY (GPD)	500
MIN. PRIMARY TANK VOLUME (GAL.)	500
REACTOR TANK VOLUME (GAL.)	710
MEDIA SIZE	4' X 2' X 2'
AIR REQUIREMENTS	12 CFM



INFILTRATOR WATER TECHNOLOGIES, LLC
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475
 WWW.INFILTRATORWATER.COM
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM



E50NCM

PART NO.
E50N
 DATE
 06/26/2024
 SCALE
1:40
 SHEET NO.
01 of 01