


NOTES:

- FOR DESIGNS WITH TREATMENT CAPACITIES GREATER THAN 1,500 GPD, CONTACT INFILTRATOR FOR REVIEW.
- OPTIONAL SCHEDULE 40 PVC INSERT INSTALLED TO RAISE ECOPOD TO INLET AND OUTLET HEIGHT REQUIREMENTS.

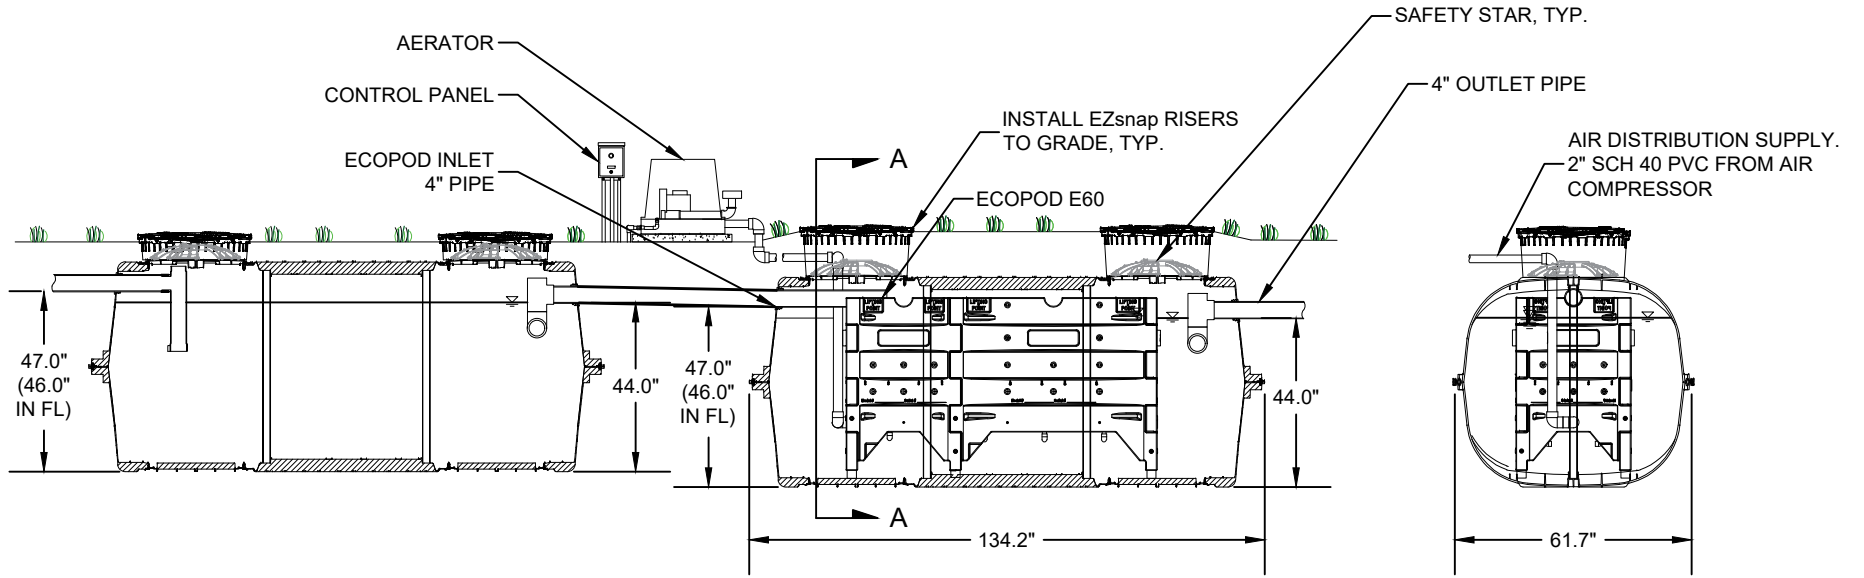

ELEVATION VIEW

SECTION A-A

ELECTRICAL REQUIREMENTS

TREATMENT PLANT	E75N
AERATOR	DELTA MODEL 06
MOTOR FULL LOADS AMP	4.7
MEASURED OPERATING WATTS	280
ELECTRICAL REQUIREMENTS	115V - 1PH

ECOPOD SPECIFICATIONS

TREATMENT PLANT	E75N
TREATMENT CAPACITY (GPD)	750
MIN. PRIMARY TANK VOLUME (GAL.)	750
REACTOR TANK VOLUME (GAL.)	916
MEDIA SIZE	6' X 2' X 2'
AIR REQUIREMENTS	18 CFM



INFILTRATOR WATER TECHNOLOGIES, LLC  
 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475  
 WWW.INFILTRATORWATER.COM  
 PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM



E75NCM

PART NO.  
**E75N**  
 DATE  
 07/8/2024  
 SCALE  
**1:50**  
 SHEET NO.  
**01 of 01**