


Q:\Technical Resources New\02-151- PRODUCTS\2022 Drawings\completed ENVIRO-AIRE in IM-series

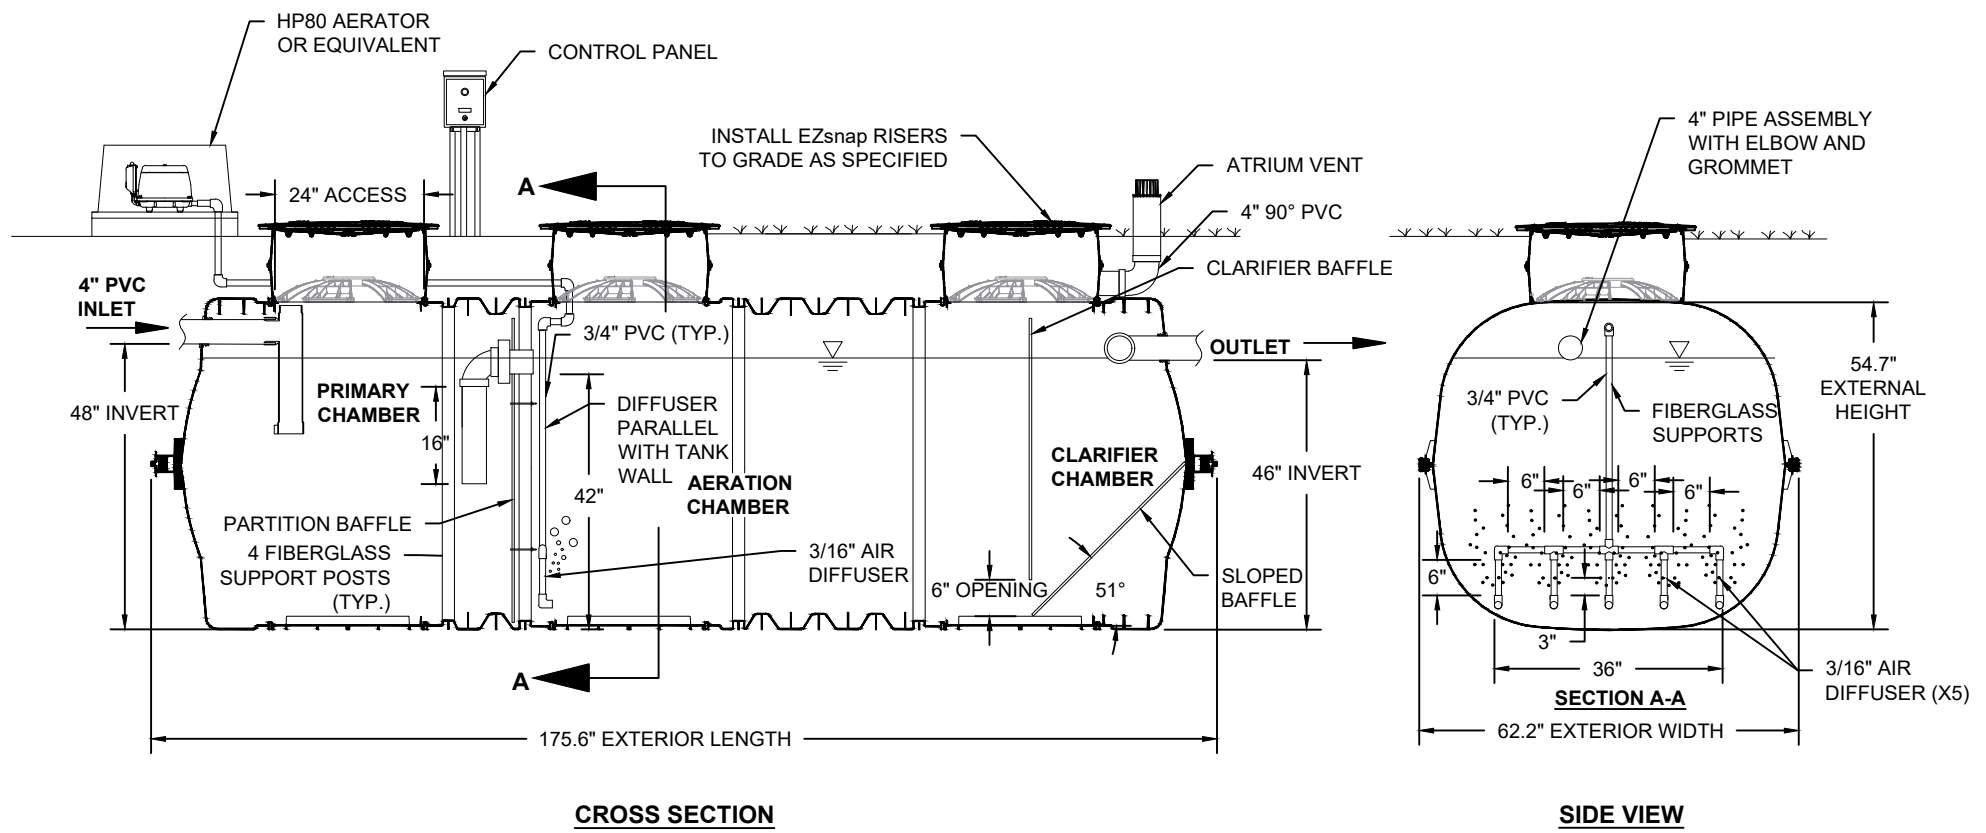

- NOTES:**
1. INSTALL ENVIRO-AIRE AEROBIC TREATMENT UNIT PER INSTALLATION INSTRUCTIONS.
  2. INSTALL TANK PER INSTALLATION INSTRUCTIONS.
  3. AERATOR INSTALLED WITHIN 100 FT OF THE TANK.

TREATMENT PLANT	TREATMENT CAPACITY (GPD)	TOTAL VOLUME (GAL.)	PRIMARY VOLUME (GAL.)	AERATION VOLUME (GAL.)	CLARIFIER VOLUME (GAL.)	BOD LOADING (LBS/DAY)
EA75	750	1,604	515	813	276	1.875

REV.	DATE	INITIALS
A	8/31/2022	KJ
B	1/10/2023	ADP
C	2/15/2023	KJ

Infiltrator – Walker  
 15785 Industry Way, Walker, LA 70785  
 (800) 219-9183

COPYRIGHT (C) 2022 DELTA TREATMENT SYSTEMS, LLC (DTS). INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF DTS. NO PART OF THIS DRAWING SHALL BE REPRODUCED, DISTRIBUTED, DISCLOSED, OR USED BY ANY PERSON OR ORGANIZATION, IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN PERMISSION OF DTS. THIS INFORMATION IS BASED ON SPECIFIC INPUT PARAMETERS AND IS FOR BUDGETARY OR PRELIMINARY USE ONLY. USE AND INTERPRETATION OF THIS INFORMATION AND DETERMINING THE APPLICABILITY TO A SPECIFIC PROJECT IS AT THE SOLE DISCRETION OF THE USER AND/OR THE ENGINEER OF RECORD.

IM-1530 WITH ENVIRO-AIRE EA75

---

CROSS SECTION AND SIDE VIEW

HORIZ. SCALE N.T.S.	PROJECT NO. N/A
VERT. SCALE N/A	DATE 09/16/2020
DRAWN BY JLK	DESIGNED BY DTS
DRAWING NO. N/A	SHEET NO. 01 of 01