




- NOTES:
 1. INSTALL TANK, ECOFILTER, AND CONTROL PANEL PER INSTALLATION INSTRUCTIONS.
 2. THE INLET CAN BE RAISE A MAXIMUM OF 1" TO 48" TO PROVIDE A GREATER VOLUME

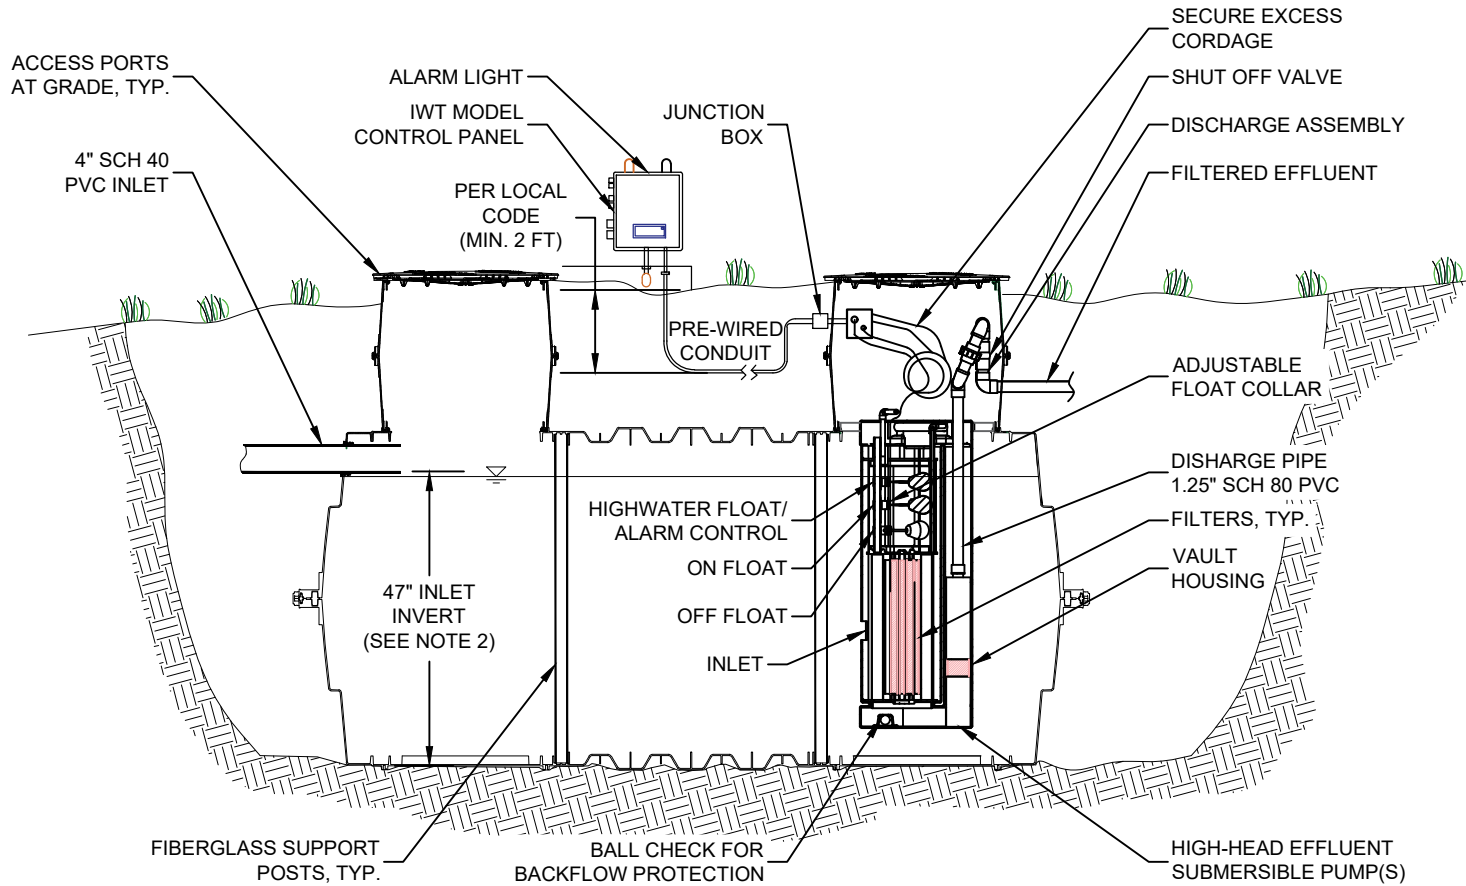

Q:\Technical Resources\New\00-PROPOSALS\Website Drawings\Detail\EcoFilter\IM-1060 ECOFILTER Pump Vault.dwg

| | | |
|---|---|------------|
|  |  | PART NO. |
| | | P/N |
| INFILTRATOR WATER TECHNOLOGIES, LLC 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475 WWW.INFILTRATORWATER.COM PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM | | DATE |
| | | 07/23/2024 |
| ECOFILTER PUMP VAULT 49" INSTALL WITH IM-1060 TANK | | SCALE |
| | | 1:30 |
| | | SHEET NO. |
| | | 01 of 01 |