




NOTES

1. INSTALL TANK, ECOFILTER, AND CONTROL PANEL PER INSTALLATION INSTRUCTION.
2. THE INLET CAN BE RAISED A MAXIMUM OF 1" TO 48" TO PROVIDE A GREATER VOLUME.

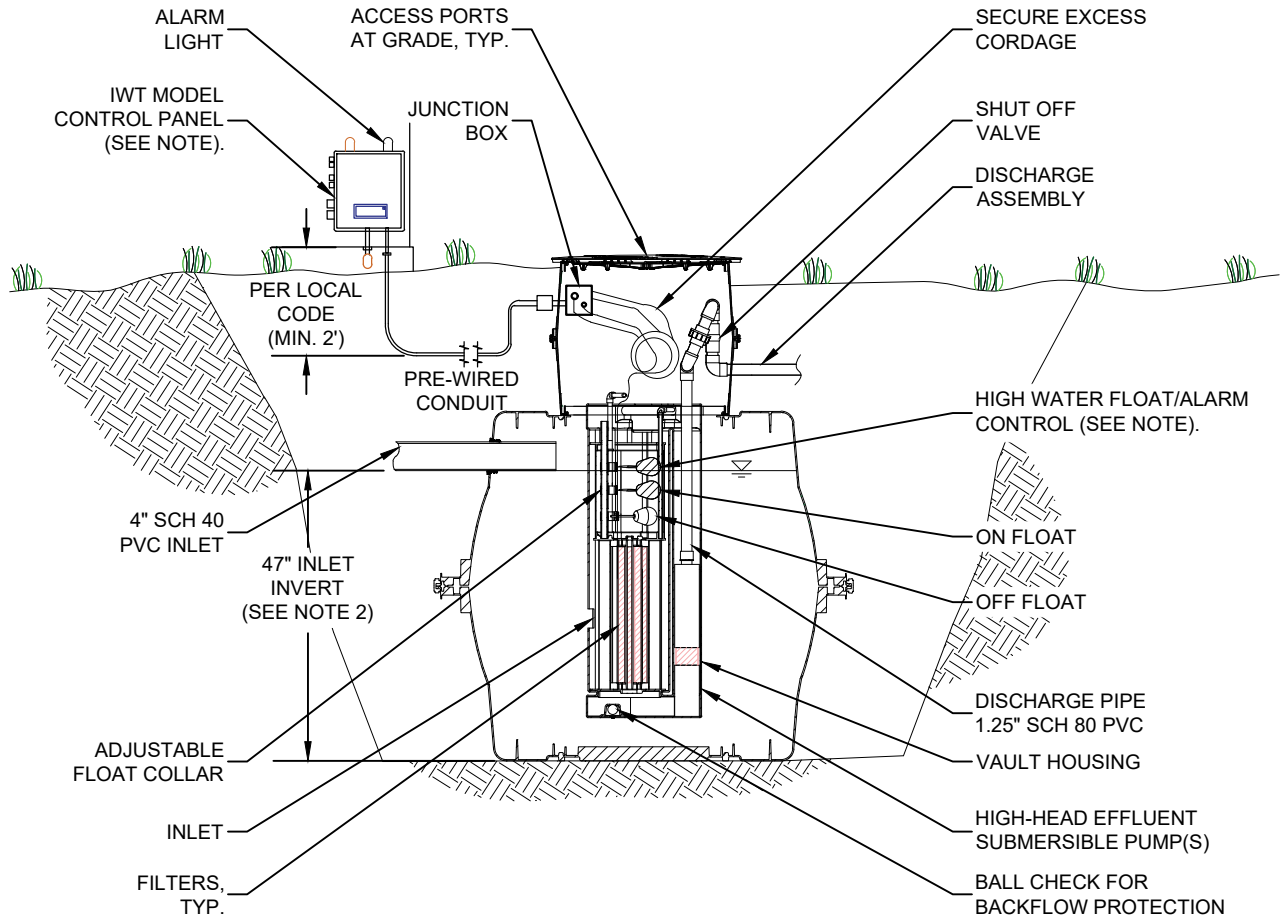

Q:\Technical Resources\New\00-PROPOSAL\Website Drawings\Detail\EcoF Item\IM-540 ECOFILTER Pump Vault.dwg

		PART NO.
		P/N
INFILTRATOR WATER TECHNOLOGIES, LLC 4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475 WWW.INFILTRATORWATER.COM PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM		DATE
		07/2/2024
<b>ECOFILTER PUMP VAULT 49"</b> <b>INSTALL WITH IM-540 TANK</b>		SCALE
		1:30
SHEET NO. <b>01 of 01</b>		SHEET NO.
		01 of 01